

Powerware Series

**Eaton® ConnectUPS Web /SNMP Card
Quick Start Instructions
X and BD Models**



Powering Business Worldwide

Eaton, Powerware, LanSafe, and PowerVision are registered trademarks and ConnectUPS, X-Slot, BestDock, and CoreLogic are trademarks of Eaton Corporation or its subsidiaries and affiliates. Microsoft and Windows are registered trademarks of Microsoft Corporation. HyperTerminal is a registered trademark of Hilgraeve. Modbus is a registered trademark of Modicon. IBM and AS/400 are registered trademarks of International Business Machines, Inc. All other trademarks are property of their respective companies.

©Copyright 2005–2010 Eaton Corporation, Raleigh, NC, USA. All rights reserved. No part of this document may be reproduced in any way without the express written approval of Eaton Corporation.

Checklist

1. Verify that all of the following items are available:

- ConnectUPS Web/SNMP Card package contents (see front cover)
- Phillips screwdriver
- Microsoft® Windows® operating system (for other operating systems, see the help file on the Software Suite CD)
- Available serial port (RS-232)
- HyperTerminal® (ships with Windows) or equivalent terminal emulation application
- Internet Explorer Web browser

2. Contact your local network administrator for the following mandatory network settings:

- IP Address (static address*) . . .
- Gateway IP Address . . .
- Network Mask IP Address . . .

*If you are setting up the ConnectUPS Card in a DHCP environment, the network administrator must set up the DHCP server to provide a static address each time the card makes a DHCP request. Provide the network administrator with the card's MAC address (on the bottom of the card):

- MAC address

3. If you need e-mail functionality, obtain the following network settings (either SMTP only or DNS and Host Name):

- SMTP (mail server) IP Address . . .
- DNS (name server) IP Address . . .
- Host Name

Refer to the *ConnectUPS Web/SNMP Card User's Guide* PDF on the Software Suite CD for detailed setup information.

4. List the applicable UPS load segment (receptacle group) connections (refer to the UPS user's guide to see if load segments are available for your UPS):

- Load Segment 1 is connected to
- Load Segment 2 is connected to
- Load Segment 3 is connected to

Examples of load segment equipment connections are "CPU MX1," "Monitor MX1," and "Router San Diego 1."

Section 1

Install the Card

The hot-swappable ConnectUPS Web/SNMP Card can be installed without turning off the UPS or disconnecting the load.

The following steps explain how to install the ConnectUPS-X or ConnectUPS-BD:

1. Verify that both DIP switches on the card are set to the **0** (off) position (see Figure 1).

NOTE If you are setting up the ConnectUPS Card in a DHCP environment, set DIP switch 2 to the **1** (on) position.

2. Remove the X-Slot™ or BestDock™ cover on the UPS rear panel. Retain the screws.

NOTE If there is another card already installed with an attached communication cable, disconnect the cable and then remove the card.

3. To prevent electrostatic discharge (ESD), place one hand on a metal surface such as the UPS rear panel.
4. Slide the card into the open slot and secure with the screws removed in Step 2 (see Figure 2 and Figure 3).
5. Connect an active Ethernet cable (supplied) to the Uplink Ethernet connector on the ConnectUPS-X or to the network connector on the ConnectUPS-BD (see Figure 4).
6. To configure the card locally using the supplied configuration cable, continue to the following section, "Connect the Card."

To configure the card remotely through a network using a Web browser or Telnnet (or similar) utility, refer to the *ConnectUPS Web/SNMP Card User's Guide* PDF on the Software Suite CD.

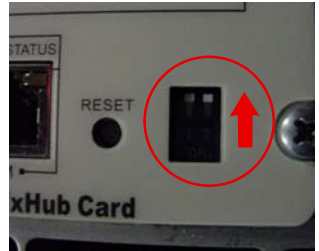


Figure 1. Verify DIP Switches



Figure 2. Install the ConnectUPS Card



Figure 3. Secure the ConnectUPS Card

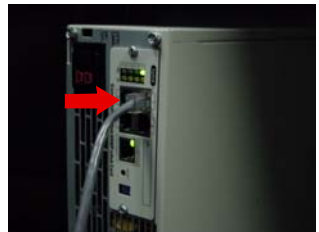


Figure 4. Install the Ethernet Cable

Section 2

Connect the Card

To connect the card to the computer and start the configuration:

1. Plug the RJ-45 end of the supplied configuration cable (labeled “PC”) into the COM port on the card (see Figure 5).

Verify that you have used the port labeled “COM.” The other ports on the card will not work for configuration.

2. Plug the other end of the serial cable into the serial COM port on the computer.
3. Open your terminal emulation program (such as HyperTerminal).
4. Select the appropriate serial connection (such as COM1). See Figure 6.
5. Set the serial line to 9600 baud, No parity, 8 data bits, 1 stop bit, and no flow control (see Figure 7).
6. Verify that the UPS is turned on.
7. After a few seconds, press Enter. The Password prompt appears (see Figure 8).

If the Password prompt does not appear, press Enter again. If it still does not appear, check the following conditions:

- Verify the serial line is set to 9600 baud, No parity, 8 data bits, 1 stop bit, and no flow control.
- If the serial line settings are correct, check the cabling to verify all connections are secure.
- Verify that your terminal program is on the correct communication port for the serial connection.
- Verify that the card has power (one or more LEDs on the card are illuminated). The UPS should be turned on.

8. Type your *password* (the default is *admin*) and press Enter. The Main Menu screen appears.



Figure 5. Install Configuration Cable




Figure 6. Select Connection



Figure 7. Configure Port Settings

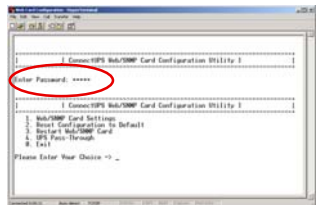


Figure 8. Enter Configuration Password

Section 3

Configure the Card

To configure the card after you have connected it:

1. Type **1** on the Main Menu to display the Web/SNMP Card Settings screen (see Figure 9).
2. Type **1** to display the Set the IP Address, Gateway Address and MIB System Group screen (see Figure 10).
3. To set the IP Address, type **1** and press **Enter**. Type the IP Address and press **Enter**. (see the Checklist).
4. Type **0** to return to the previous menu.
5. Repeat Steps 3 and 4 to set the Gateway Address and Network Mask.
6. Change any other options as needed for your particular configuration by typing the corresponding number shown in the menu.

Each Configuration Menu setting is described in detail in the Appendix of the *ConnectUPS Web/SNMP Card User's Guide*. You can change the other options later if you prefer.

7. Type **0** until you return to the Main Menu (see Figure 11).
8. Type **0** to save all settings and exit the card configuration.
9. Verify network communication by using a Web browser (see Figure 12). Type the IP Address of your card and select **Go**. The ConnectUPS Card summary page opens.

NOTE Once the card is reachable on the network, you can use a Web browser, Telnet, or similar utility to adjust any of the configuration settings. The menus are identical to those seen during serial configuration and are password-protected for Superuser access only.

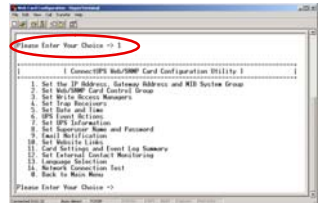


Figure 9. Configure Card Settings

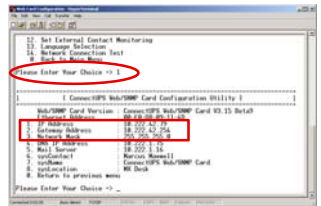


Figure 10. Set ConnectUPS Card IP Address


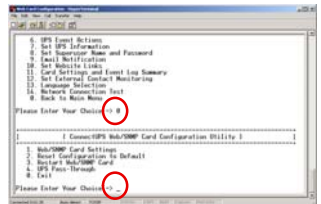


Figure 11. Save and Exit

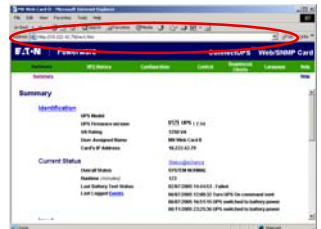

Section 4

Install Shutdown Software

NOTE The following procedure applies to NetWatch shutdown software for Microsoft Windows operating systems. For other operating systems, refer to the NetWatch help file on the CD.

NOTE For other software, such as LanSafe® Power Management Software or PowerVision® Software, refer to those user guides for instructions.

Use the following procedure to install NetWatch software after you have installed and configured the card:

1. Insert the Software Suite CD into the computer's CD-ROM drive. The CD menu displays after a few seconds.
2. Select **Software Wizard** from the Main Menu.
3. Select **Install NetWatch** (see Figure 13).
4. Select the operating system.
5. Select **Launch the Installer** (see Figure 14).
6. Select **Open** in the File Download dialog box and follow the installation instructions until the Select Powerware Shutdown Server window displays.
7. Select **Manually Enter IP Address for the Shutdown Server** (see Figure 15).
8. Type the IP Address of the card and select **OK**.
9. Select the correct UPS load segment that your computer's power cord is plugged into and select **OK** (see Figure 16).



Figure 13. Install NetWatch Software

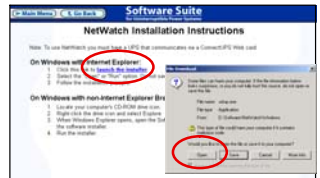


Figure 14. Launch NetWatch Software

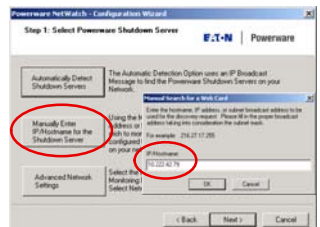


Figure 15. Enter ConnectUPS Card IP Address

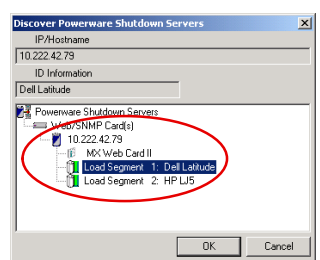


Figure 16. Select UPS Load Segment

10. Select your preferred method of shutting down your system (see Figure 17). The default selection is recommended. Select **Next**.
 11. The Event and Logging Options dialog opens (see Figure 18). Select **Next**.
 12. Verify the configuration settings are correct and select **Finish** (see Figure 19).
 13. A pop-up message indicates that communication with the card is established (see Figure 20). Select **Clear** to acknowledge the message.
 14. Repeat Steps 1 through 13 on all computers powered by the corresponding UPS using this specific card.
- NetWatch installation and configuration is now complete.

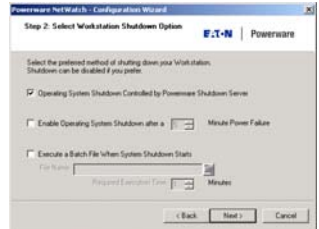


Figure 17. Verify Configuration Settings

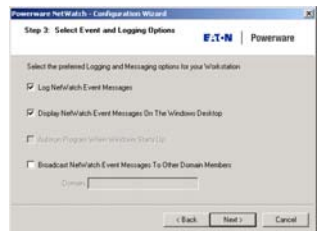


Figure 18. Verify Configuration Settings

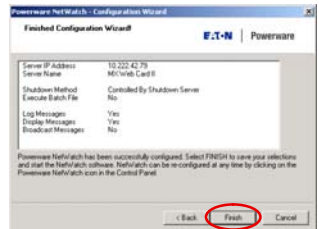


Figure 19. Verify Configuration Settings

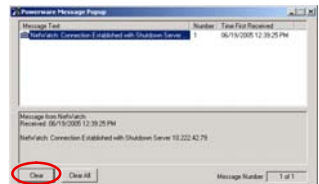


Figure 20. Clear Communication Message



164950185 B